


1	TAG NO	D11V2511	D11V2512	D11V2513
2	SERVICE	BULK CEMENT	BULK CEMENT	BULK CEMENT
3	DESIGN/OP PRES (BAR/G)	6 / 5.5	6 / 5.5	6 / 5.5
4	DESIGN/OP TEMP (C)	20 +40/AMB	20 +40/AMB	20 +40/AMB
5	CAPACITY (m3)	42 m3 operating	42 m3 operating	42 m3 operating
6	VOLUME (m3)	50	50	50
7	VENDOR	CAVERION	CAVERION	CAVERION

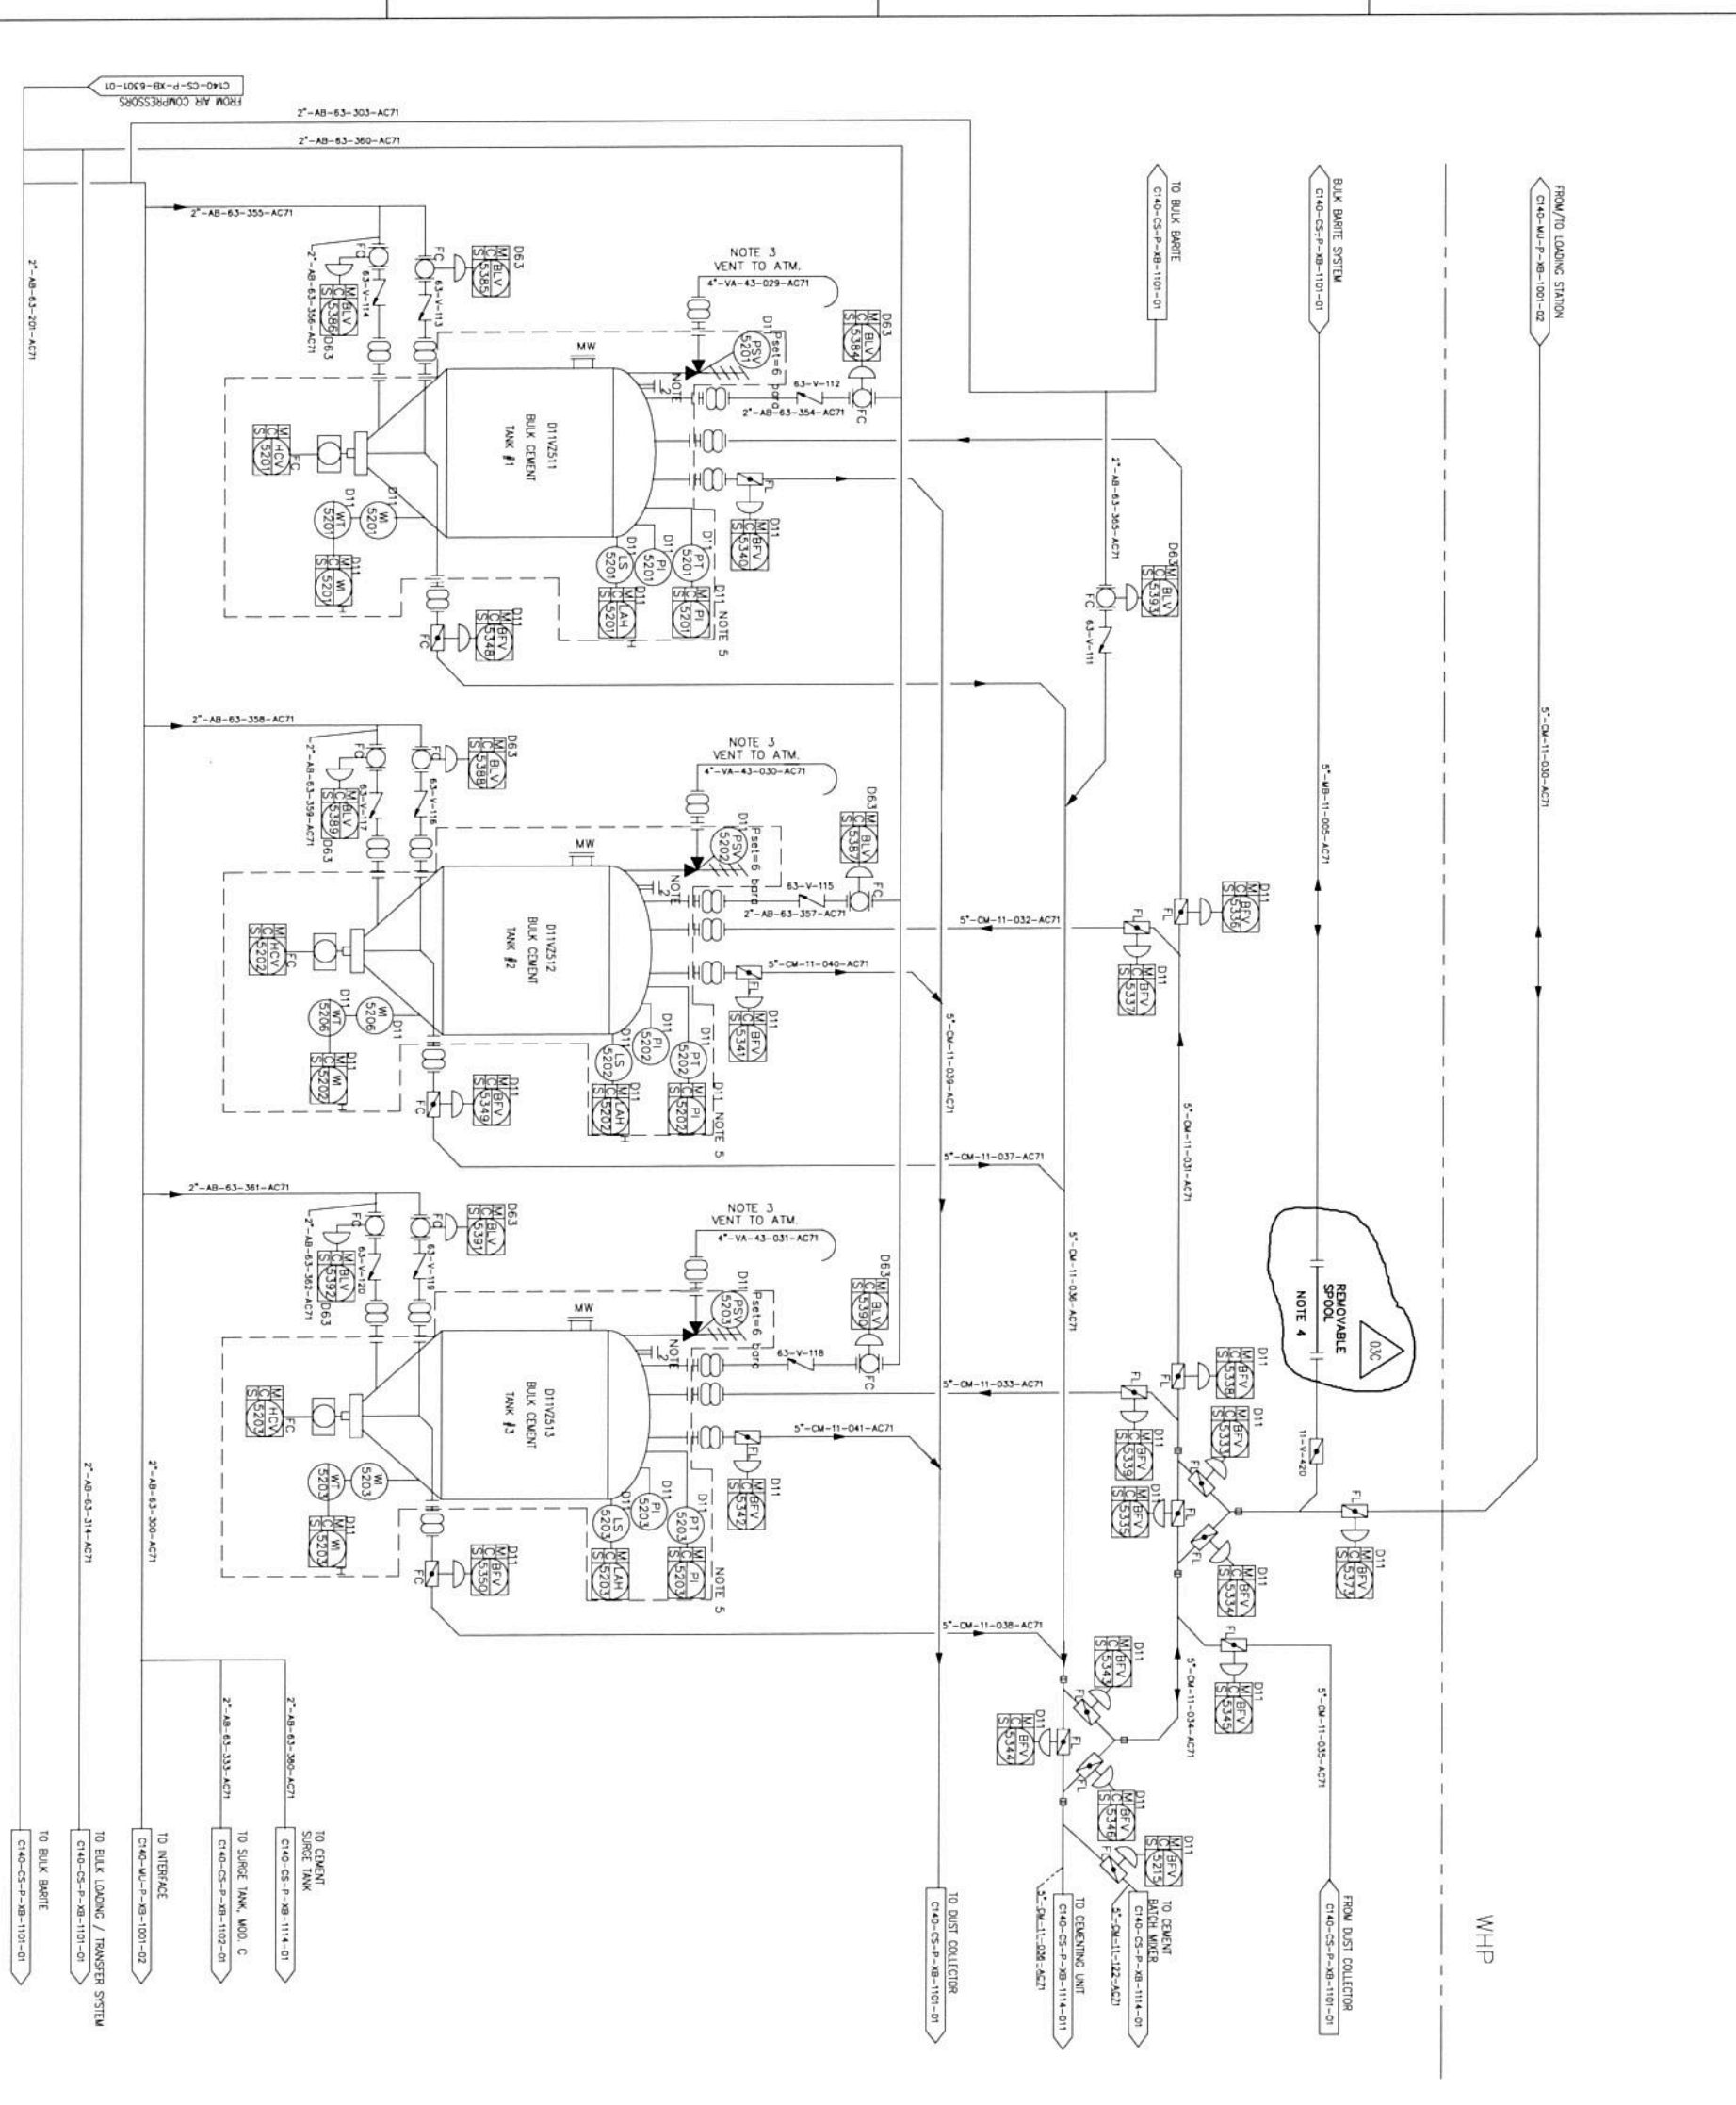

MODULE E2

- REFERENCE DRAWINGS
- C140-CS-P-XB-1101-01
  - C140-CS-P-XB-1102-01
  - C140-CS-P-XB-1114-01
  - C140-MU-P-XB-1001-02
  - C140-CS-P-XB-6301-01

- NOTES
1. NOS. OF PURGE CONNECTION TO BE DETERMINED TO BULK PIPE ROUTING
  2. BLIND FLANGE FOR MANUAL SOUNDING, 2"
  3. ROUTED TO UNMANNED SECURE AREA
  4. REMOVABLE SPOOL NORMALLY NOT CONNECTED
  5. ALARM FOR HIGH PRESSURE SHALL BE SET LOWER THAN PSV

03C	RE ISSUED FOR CONSTRUCTION	BVE	ASA	KKL	20.09.2017
02C	RE ISSUED FOR CONSTRUCTION	BVE	AND	KKL	20.09.2016
01C	ISSUED FOR CONSTRUCTION	BVE	AND	KKL	06.07.2016

**CAMERON**  
A Schlumberger Company

**Statoil**

DRAWING N. NO.	C140-CS-P-XB-1103-01	REV.	03C
DRAWING N. DATE	02-MAR-2016	REV.	02C
DRAWING N. CAMERON	25-035-PA01-A-XK-003	REV.	02
FORMAT:	SCALE	PAGE:	
BULK_CEMENT_STORAGE_&_TRANSFER	SCALE	PAGE:	