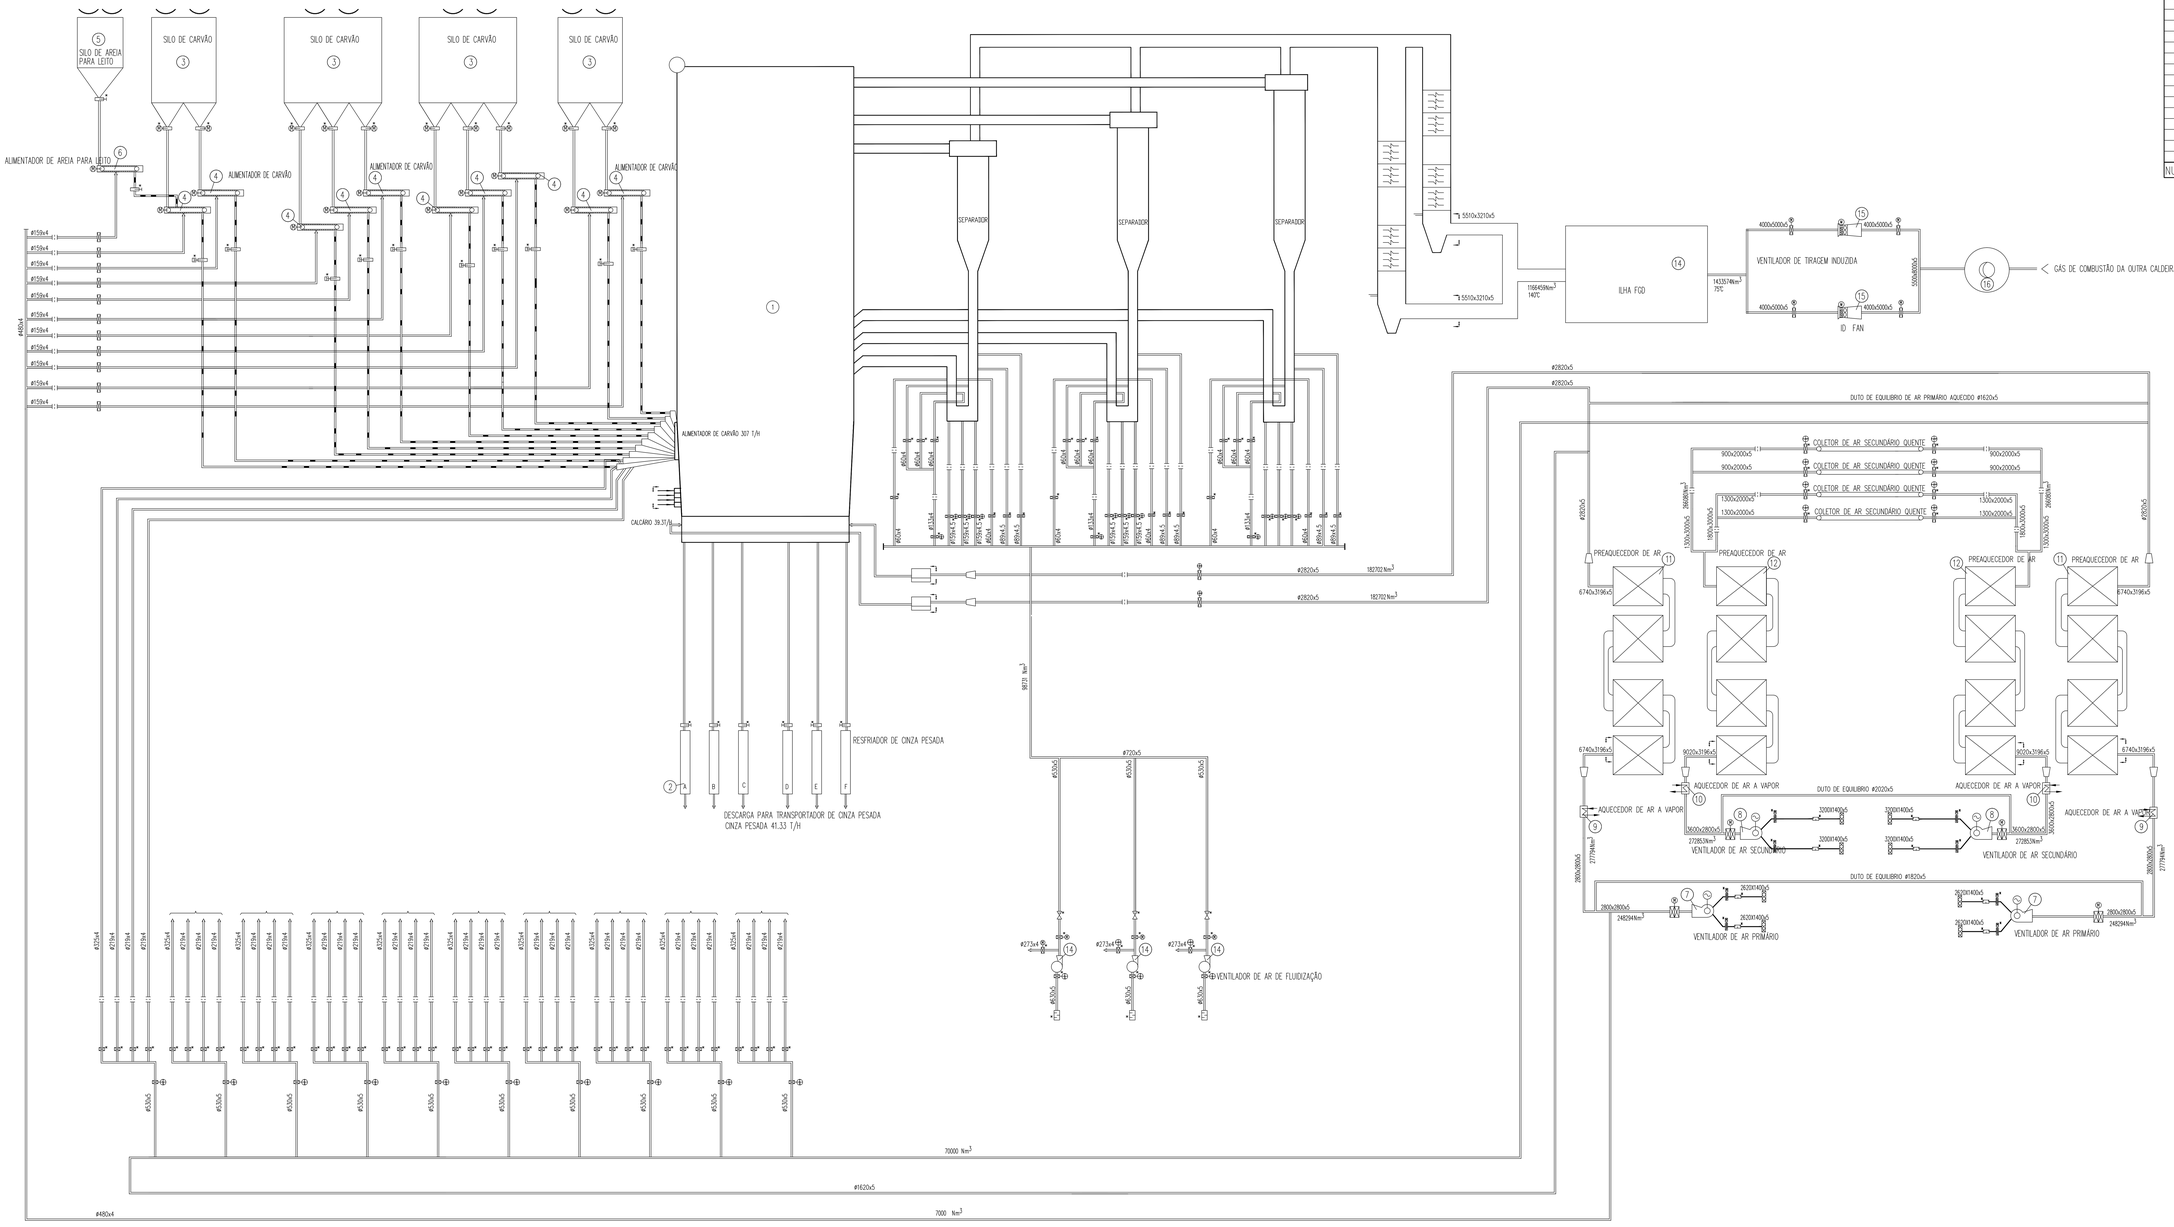

NUM.	ITEM	ESPECIFICAÇÃO	QNTD	OBSERVAÇÕES
16	CHAMINÉ	200m	1	PARA 2 CALDEIRAS
15	VENTILADOR DE TIRAGEM INDUZIDA	FLUXO: 600AL 1089.98Nm³/h 11100Pa	2	
14	ILHA FGD		1	
13	VENTILADOR DE AR DE FLUIDIZAÇÃO	CENTRÍFUGO 1318.3m³/h 66000Pa	3	
12	PREAQUECEDOR DE AR		2	
11	PREAQUECEDOR DE AR		2	
10	AQUECEDOR DE AR A VAPOR		2	
9	AQUECEDOR DE AR A VAPOR		2	
8	VENTILADOR DE AR SECUNDÁRIO	CENTRÍFUGO 364.02m³/h 15600Pa	2	
7	VENTILADOR DE AR PRIMÁRIO	CENTRÍFUGO 331.92m³/h 24300Pa	2	
6	ALIMENTADOR DE AREIA PARA LEITO	2t/h	1	
5	SILO DE AREIA PARA LEITO		1	
4	ALIMENTADOR DE CARVÃO	4t/h	10	
3	DEPÓSITO DE CARVÃO		4	
2	RESFRIADOR DE CINZA PESADA	2t/h	6	
1	CALDEIRA DE LEITO FLUIDIZADO CIRCULANTE	1025t/h 17.5MPa,541℃/541℃	1	

REV.	DATA	DESENHISTA	PROJETADO	VERIFICADO	REVISADO	APROVADO	DESCRIÇÃO
A	14/07/2015						

ute Ouronegro — UTE Ouro Negro SPE S/A, Porto Alegre / RS / Brasil

SEPCO1 Electric Power Construction Corporation

Nwepdi — COPYRIGHT © ALL RIGHTS RESERVED. THIS DRAWING IS FOR THE EXCLUSIVE USE OF NWEPDI AND SHALL NOT BE REPRODUCED, USED FOR PURPOSES OTHER THAN THOSE AUTHORIZED BY NWEPDI, NOR DISCLOSED TO THIRD PARTIES WITHOUT NWEPDI'S PRIOR WRITTEN PERMISSION.

PROJETO: UTE Ouro Negro 2x300MW
Pedras Altas / RS / Brasil

FASE DO PROJETO: BÁSICO

DIAGRAMA DE FLUXO DE AR E GÁS DE COMBUSTÃO

Idioma: mm | ESCALA: 1:1 | DES Nº: ITB151-J01-01 | FOLHA 1 DE 1 | REV: A